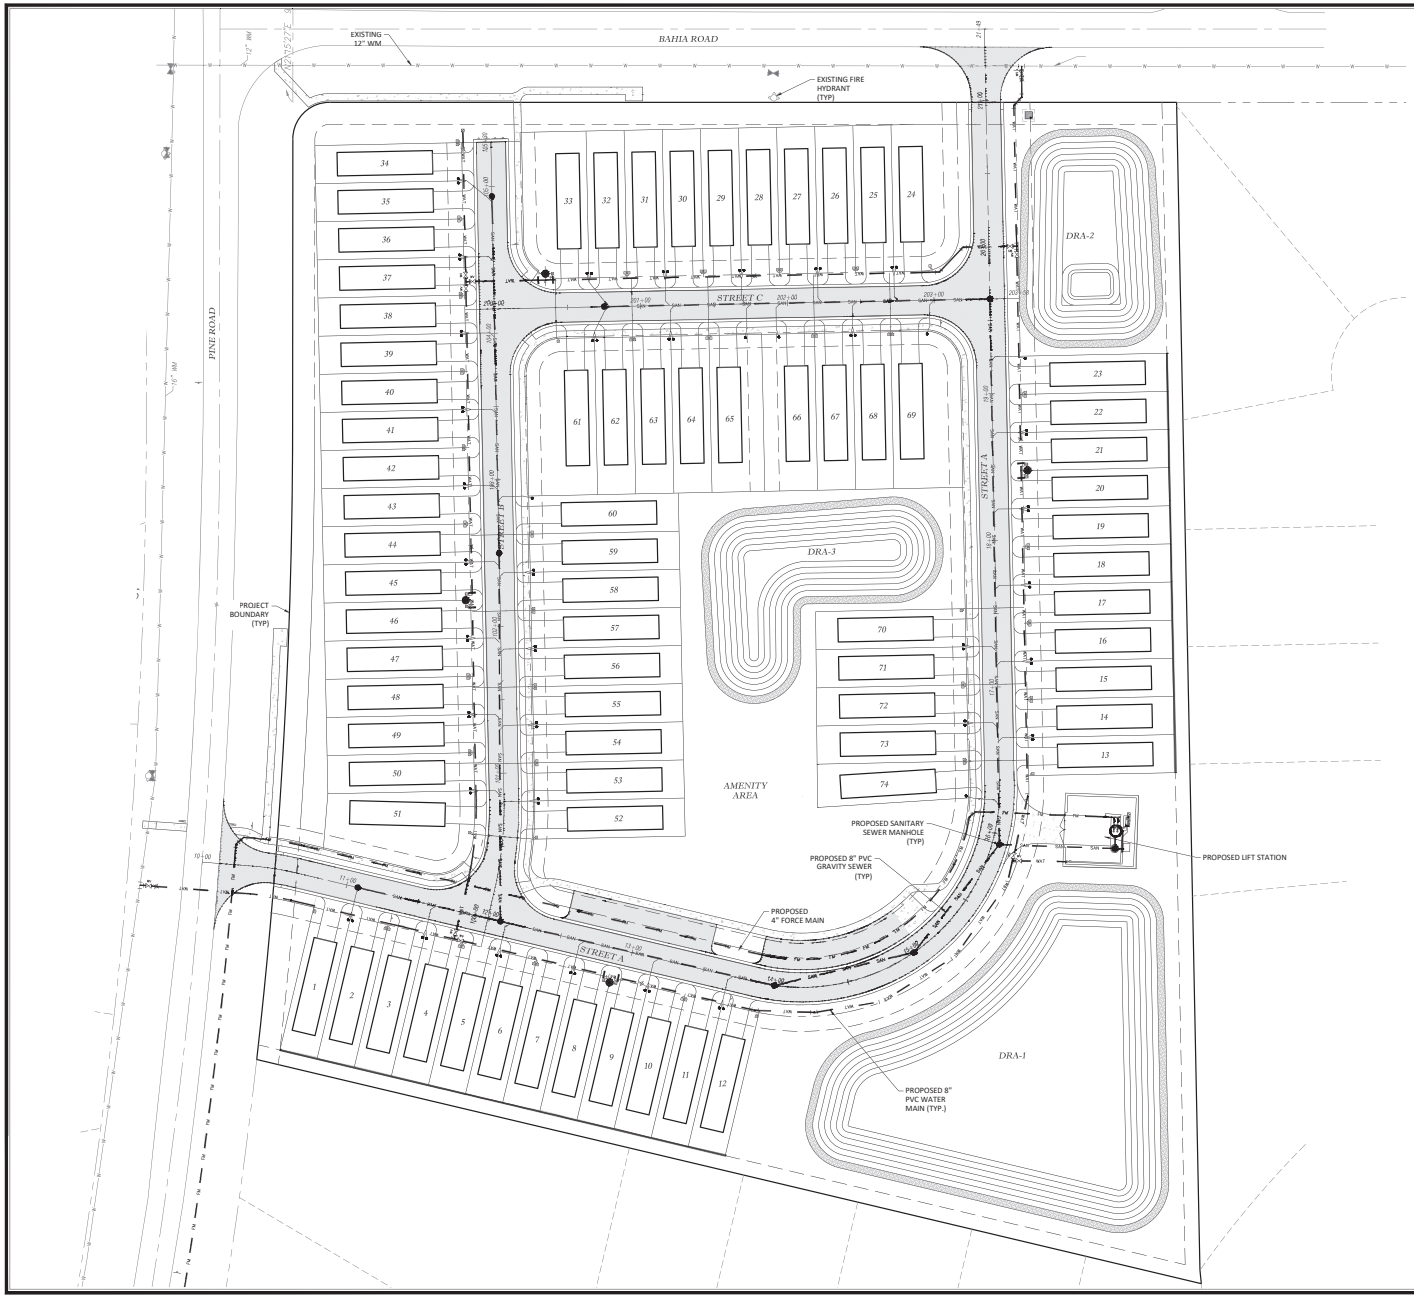

Marion County Approval Stamp

40' 20' 0 40' 80'
SCALE IN FEET
1" = 40'

WATER LEGEND:

- WAT — WATER MAIN
- FIRE HYDRANT ASSEMBLY (FHA)

SANITARY SEWER LEGEND:

- SAN — SANITARY SEWER
- MANHOLE
- FM — FORCE MAIN

NOTES

1. A METERED JUMPER CONNECTION WITH A RP BACKFLOW PREVENTION ASSEMBLY IS REQUIRED BETWEEN THE EXISTING WATER MAIN AND NEWLY INSTALLED WATER MAIN UNTIL ALL CLEARANCES HAVE BEEN APPROVED AND ACCEPTED BY MARION COUNTY. THE VALVE (OR VALVES) BETWEEN EXISTING AND PROPOSED SHALL REMAIN OFF UNTIL AUTHORIZED PERSONNEL OF MARION COUNTY DEEM APPROPRIATE TO PLACE INTO SERVICE. WATER UTILIZED DURING CONSTRUCTION SHALL BE BILLED TO THE OWNER/APPLICANT LISTED ON THE IMPROVEMENT PLANS.
2. ALL FIRE HYDRANTS TO BE PAINTED ACCORDING TO FLOW RATES AND NFPA 291 STANDARDS
3. LOCATION OF SERVICE AND METERS ARE FOR GRAPHICAL PURPOSES ONLY, ACTUAL LOCATIONS ARE PER MARION COUNTY DETAIL TS006, SHEET 26.
4. ALL EXISTING BUILDINGS, WELLS, OVERHEAD UTILITIES AND RELATED HARDWARE TO BE REMOVED BY OTHERS.

CONTRACTOR TO FIELD VERIFY ALL UTILITY LOCATIONS AND DEPTHS

ALL PROPOSED POTABLE WATER AND SANITARY SEWER INFRASTRUCTURE SHALL COMPLY WITH THE LATEST MARION COUNTY SPECIFICATIONS.

Tillman & Associates
ENGINEERING, LLC.
CIVIL ENGINEERING - PLANNING - LANDSCAPE ARCHITECTURE - ENVIRONMENTAL
1720 SE 16th Ave, Bldg 100, Ocala, FL 34471
Office: (352) 387-4540 Fax: (352) 387-4545
CERTIFICATE OF AUTHORIZATION #27095

REVISIONS

DATE

PRELIMINARY PLAT
WHISPER WOODS
MARION COUNTY, FLORIDA

MASTER UTILITY PLAN

DATE 4/2/25
DRAWN BY MR
CHKD. BY TB
JOB NO. 21-7092

SHT. 04.01

NOT VALID UNLESS SIGNED AND SEALED BY A PROFESSIONAL ENGINEER