


Exhibit A

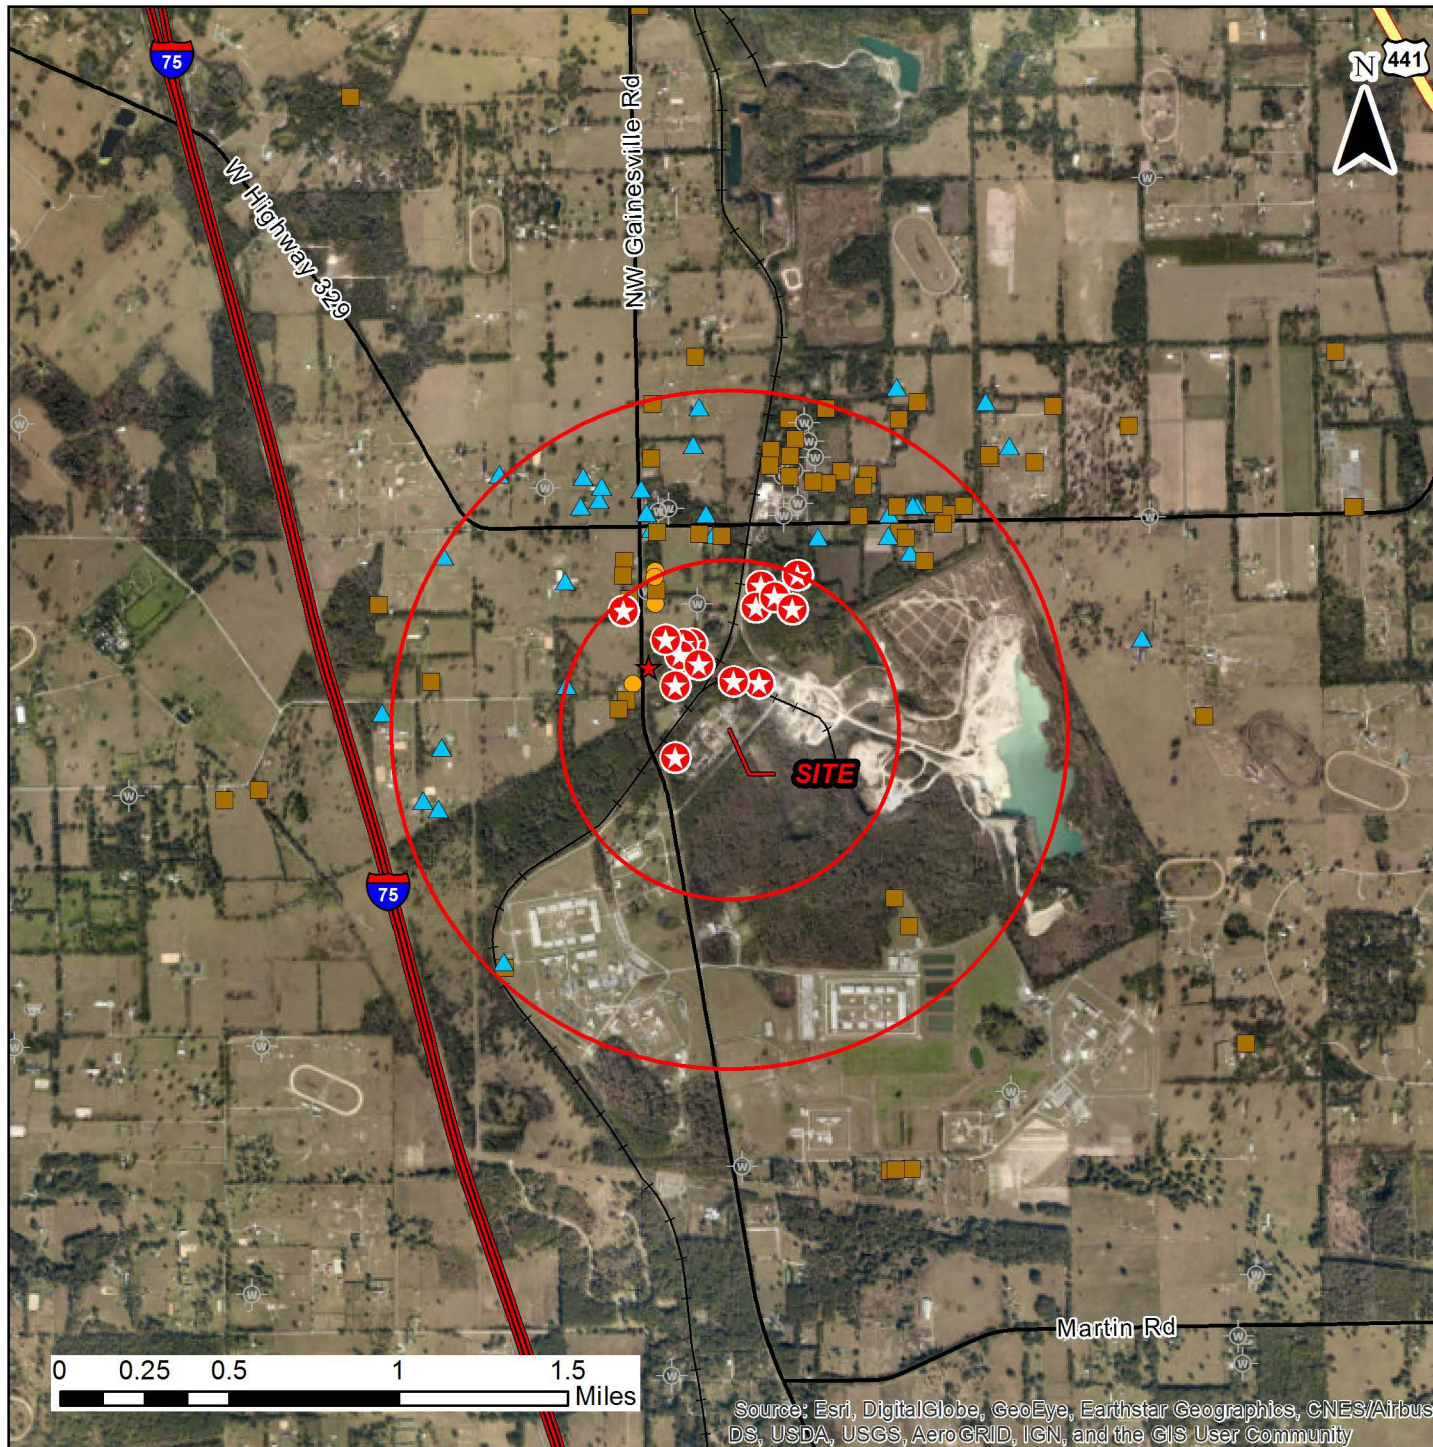

Florida State Fire College Well Sampling

PFAS Sample Results

PFAS Level

★ >HAL

★ >1/2 HAL

● >1/4 HAL

■ <1/4 HAL

▲ BDL

⊗ No Sample for this Analysis

Wells PFAS Level

15 >HAL

1 >1/2 HAL

4 >1/4 HAL

58 <1/4 HAL

32 Below Detection



Florida
Department of Health
Bureau of
Environmental Health


Disclaimer

This product is for reference purposes only and is not to be construed as a legal document. Any reliance on the information contained herein is at the user's own risk. The Florida Department of Health and its agents assume no responsibility for any use of the information contained herein or any loss resulting therefrom.

Date: 8/6/2019

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

Florida State Fire College Well Sampling

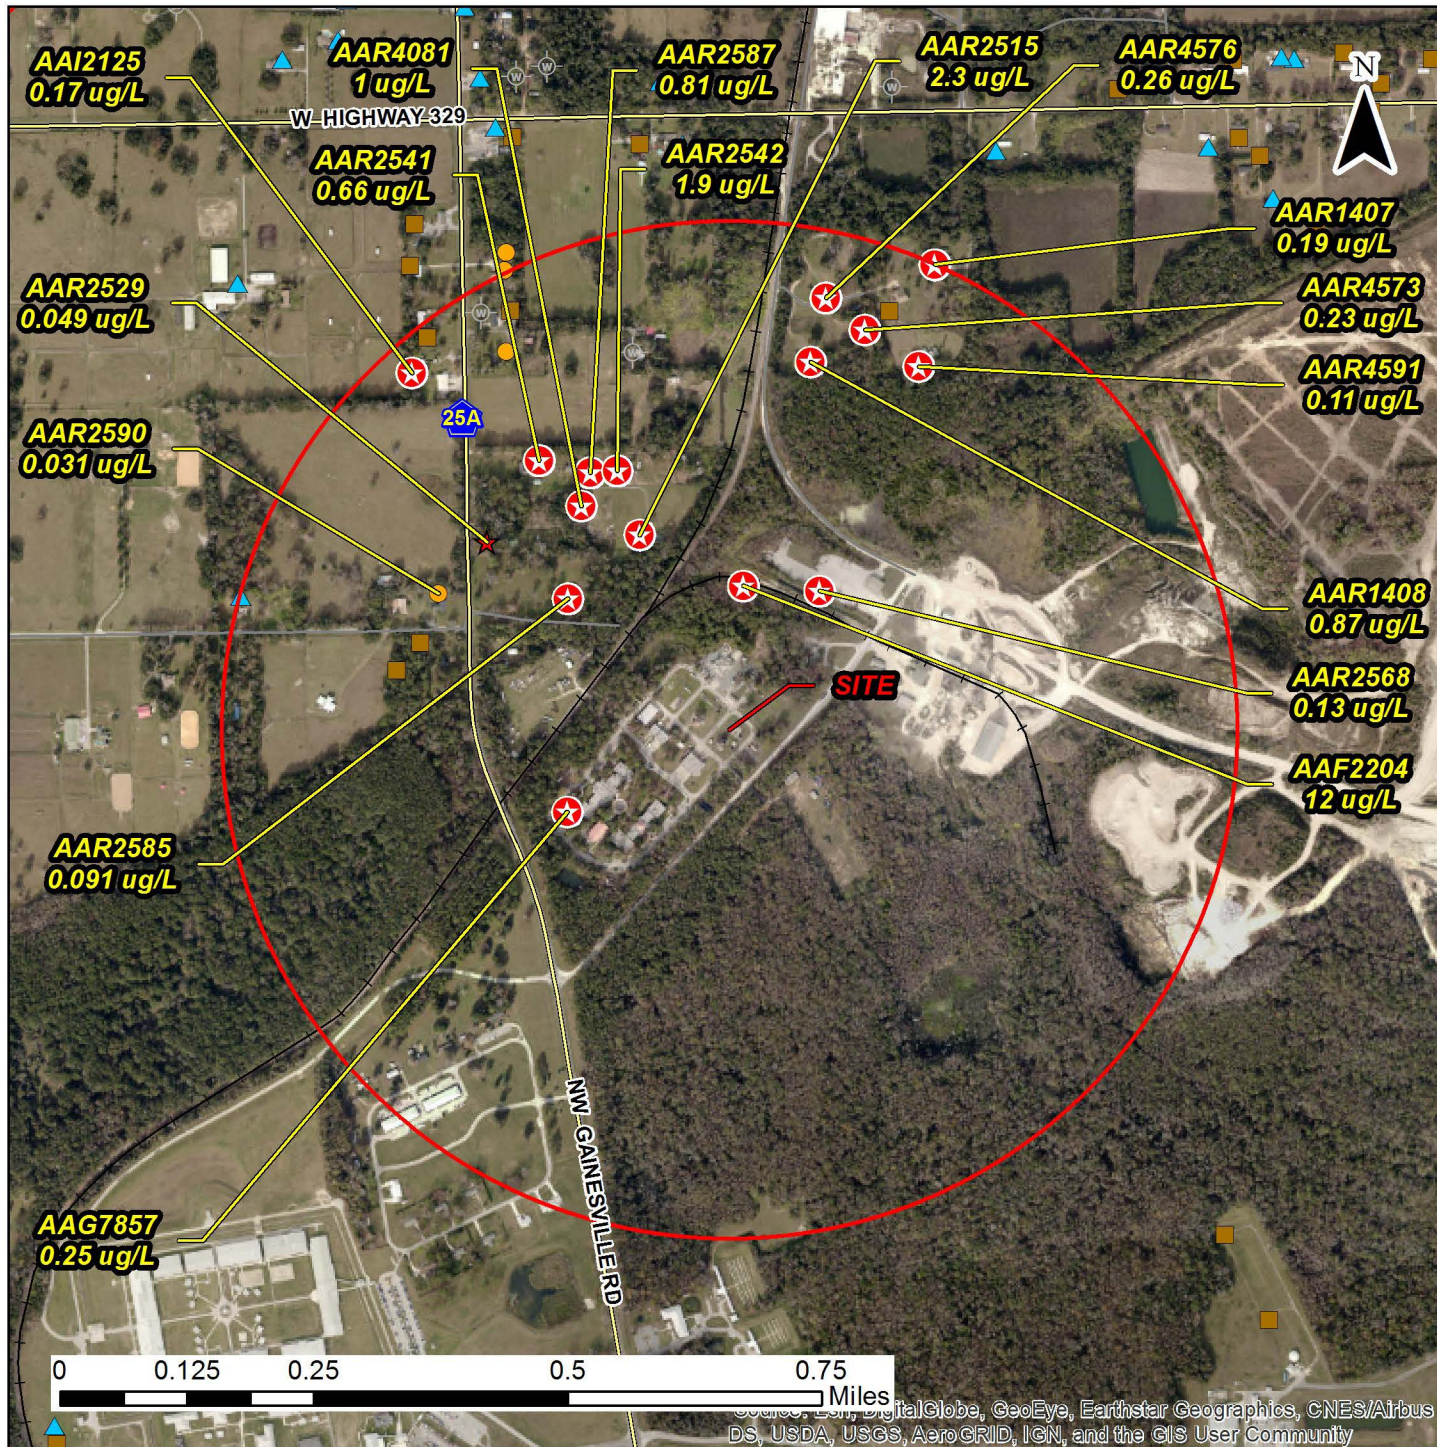

**Florida
Department of Health
Bureau of
Environmental Health**

Disclaimer

This product is for reference purposes only and is not to be construed as a legal document. Any reliance on the information contained herein is at the user's own risk. The Florida Department of Health and its agents assume no responsibility for any use of the information contained herein or any loss resulting therefrom.

Date: 8/6/2019